



Government
of Canada

Gouvernement
du Canada

Canadian General
Standards Board

Office des normes
générales du Canada

CAN/CGSB-138.3-2019

Reaffirmed May 2024

Supersedes CAN/CGSB-138.1-96



Installation of chain link fence

Canadian General Standards Board **CGSB**

SCC  CCN

Canada 

Experience and excellence

Expérience et excellence



Canadian General Standards Board statement

The CANADIAN GENERAL STANDARDS BOARD (CGSB), under whose auspices this standard has been developed, is a government directorate within Public Services and Procurement Canada. CGSB is engaged in the production of voluntary standards in a wide range of subject areas through the media of standards committees and the consensus process. The standards committees are composed of representatives of relevant interests including producers, consumers and other users, retailers, governments, educational institutions, technical, professional and trade societies, and research and testing organizations. Any given standard is developed on the consensus of views expressed by such representatives.

CGSB has been accredited by the Standards Council of Canada as a national Standards Development Organization. The standards that CGSB develops and offers as National Standards of Canada conform to the requirements and guidance established for this purpose by the Standards Council of Canada. In addition to standards it publishes as National Standards of Canada, CGSB may produce other deliverables that meet particular needs, in response to requests from a variety of sources in both the public and private sectors. CGSB standards and CGSB's National Standards are developed in conformance with the policies described in the CGSB Policy and Procedures Manual for the Development and Maintenance of Standards.

CGSB's standards are subject to review and revision to ensure that they keep abreast of technological progress. CGSB will review and publish this standard on a schedule not to exceed five years from the date of publication. Suggestions for their improvement, which are always welcome, should be brought to the notice of the standards committees concerned. Changes to standards may be issued as amendments or as new editions of standards.

An up-to-date listing of CGSB's standards, including details on latest issues and amendments, is found in the CGSB Catalogue at the following Web site, <http://www.tpsgc-pwgsc.gc.ca/ongc-cgsb/index-eng.html>, along with more information about CGSB products and services.

Although the intended primary application of this standard is stated in its scope, it is important to note that it remains the responsibility of the users of the standard to judge its suitability for their particular purpose.

The testing and evaluation of a product or service against this standard may require the use of materials and/or equipment that could be hazardous. This standard does not purport to address all the safety aspects associated with its use. Anyone using this standard has the responsibility to consult the appropriate authorities and to establish appropriate health and safety practices in conjunction with any applicable regulatory requirements prior to its use. CGSB neither assumes nor accepts any responsibility for any injury or damage that may occur during or as the result of tests, wherever performed.

Attention is drawn to the possibility that some of the elements of this standard may be the subject of patent rights. CGSB shall not be held responsible for identifying any or all such patent rights. Users of this standard are expressly advised that determination of the validity of any such patent rights is entirely their own responsibility.

For enforcement purposes, standards shall be considered published the final day of the month of their publication date.

Contact the Canadian General Standards Board

To obtain information on CGSB, its services and standards or to obtain CGSB publications, please contact us:

web — <http://www.tpsgc-pwgsc.gc.ca/ongc-cgsb/index-eng.html>
e-mail — ncr.cgsb-ongc@tpsgc-pwgsc.gc.ca
telephone — 1-800-665-2472
mail — Canadian General Standards Board
140 O'Connor Street, Tower East
Ottawa, Ontario Canada K1A 0S5

Standards Council of Canada statement

A National Standard of Canada is a standard developed by a Standards Council of Canada (SCC) accredited Standards Development Organization, in compliance with requirements and guidance set out by SCC. More information on National Standards of Canada can be found at www.scc.ca.

SCC is a Crown corporation within the portfolio of Innovation, Science and Economic Development (ISED) Canada. With the goal of enhancing Canada's economic competitiveness and social well-being, SCC leads and facilitates the development and use of national and international standards. SCC also coordinates Canadian participation in standards development, and identifies strategies to advance Canadian standardization efforts.

Accreditation services are provided by SCC to various customers, including product certifiers, testing laboratories, and standards development organizations. A list of SCC programs and accredited bodies is publicly available at www.scc.ca.

NATIONAL STANDARD OF CANADA

CAN/CGSB-138.3-2019

Reaffirmed May 2024

Supersedes CAN/CGSB-138.1-96

Installation of chain link fence

CETTE NORME NATIONALE DU CANADA EST DISPONIBLE EN VERSIONS
FRANÇAISE ET ANGLAISE.

ICS 91.090

Published May 2024 by the
Canadian General Standards Board
Ottawa, Ontario K1A 0S5

© HIS MAJESTY THE KING IN RIGHT OF CANADA,
as represented by the Minister of Public Services and Procurement,
the Minister responsible for the Canadian General Standards Board (2024).

No part of this publication may be reproduced in any form without the prior permission of the publisher.

CANADIAN GENERAL STANDARDS BOARD**Standards Committee on Wire Fencing****(Voting membership at date of ballot)****Chair**

Christina Marra Roma Fence Group of Companies Ltd. (User)

General interest category

Keith Dyer Consultant – Independent
 Martin McCooey Canadian Fence Industry Association

Producer category

Alexandre Gravel Nova Steel Inc.
 Andre Berner Protin Imports Ltd.
 Anthony Turco Metro Fence and Fittings Ltd.
 Cameron LeSavage Master Halco Corp.
 Collin Rowe Phoenix Fence Corp.
 Joe Leone Shield Fence and Wire Products
 Pamela McCracken Inc. Tree Island Steel Ltd.
 Robert J. Tower Del Metals
 Tom Legerski Ameristar Perimeter Security

User category

Brianne Davis-Meldrum Davis Fences
 Cathie Hofstetter McGowan Fence & Supply Ltd.
 John Christiaanse Defence Construction Canada
 Keith Robinson Dialog
 Ken Scherk Steelguard Fence Ltd.
 Mike Pearsall Ministry of Transportation of Ontario
 Nick Bratkowski Raybern Erectors Ltd.
 Stephen Chang Public Services and Procurement Canada – Ontario Region
 Tim Roche Provincial Fence Products Ltd.

Committee Manager (non-voting)

Astrid Lozano Canadian General Standards Board

Translation of this National Standard of Canada was conducted by the Government of Canada.

Preface

This National Standard of Canada CAN/CGSB-138.3-2019 has been reaffirmed by the Committee on Wire Fencing in May 2024.

The following definitions apply in understanding how to implement this National Standard of Canada:

- "shall" indicates a **requirement**;
- "should" indicates a **recommendation**;
- "may" is used to indicate that something is **permitted**;
- "can" is used to indicate that something is **possible**, for example, that an organization is able to do something.

Notes accompanying clauses do not include requirements or alternative requirements. The purpose of a note accompanying a clause is to separate explanatory or informative material from the text. Annexes are designated normative (mandatory) or informative (non-mandatory) to define their application.

Contents		Page
1	Scope	1
2	Normative references	1
3	Terms and definitions	2
4	General requirements	3
5	Detailed requirements	3
6	Inspection	8
7	Options.....	8

Figures

Figure 1 — Application of brace tail and truss rod	4
Figure 2 — Footing in Average Soil Conditions	6
Figure 3 — Footing in partly solid rock.....	6
Figure 4 — Footing in solid rock.....	6
Figure 5 — Tying options.....	8

Installation of chain link fence

1 Scope

This standard applies to the installation of chain link fence used in commercial and industrial applications. It gives the requirements for chain link fence installation in earth, rock, or rock with overburden of earth.

Some quantities and dimensions used in this standard are given in SI units with imperial equivalents shown in brackets where appropriate.

All imperial measurements are industry standard nominal measurements. All metric references are closest conversions to industry standard. The imperial units are regarded as being official in the event of dispute.

The testing and evaluation of a product against this standard may require the use of materials and/or equipment that could be hazardous. This document does not purport to address all the safety aspects associated with its use. Anyone using this standard has the responsibility to consult the appropriate authorities and to establish appropriate health and safety practices in conjunction with any existing applicable regulatory requirements prior to its use.

2 Normative references

The following normative documents contain provisions that, through reference in this text, constitute provisions of this National Standard of Canada. The referenced documents may be obtained from the sources noted below.

Note: The contact information provided below was valid at the date of publication of this standard.

An undated reference is to the latest edition or revision of the reference or document in question, unless otherwise specified by the authority applying this standard. A dated reference is to the specified revision or edition of the reference or document in question.

2.1 Canadian General Standards Board (CGSB)

CAN/CGSB-138.1 — *Fabric for chain link fence*

CAN/CGSB-138.2 — *Steel framework for chain link fence*

CAN/CGSB-138.4 — *Gates for chain link fence*

2.1.1 Contact information

The above may be obtained from the Canadian General Standards Board, Sales Centre. Telephone: 1-800-665-2472. E-mail: ncr.cgsb-ongc@tpsgc-pwgsc.gc.ca. Web site: <https://www.tpsgc-pwgsc.gc.ca/ongc-cgsb/index-eng.html>.

They may also be obtained from the Government of Canada Publications, Publishing and Depository Services, Public Services and Procurement Canada. Telephone: 1-800-622-6232. Email: publications@tpsgc-pwgsc.gc.ca. Web site: <https://publications.gc.ca/site/eng/home.html>.

2.2 CSA Group

CAN/CSA G164 — *Hot Dip Galvanizing of Irregularly Shaped Articles*

2.2.1 Contact information

The above may be obtained from CSA Group. Telephone: 1-800-463-6727. Web site: <https://www.csagroup.org>.

2.3 National Research Council of Canada

National Building Code of Canada (latest applicable version)

2.3.1 Contact information

The above may be obtained from the National Research Council of Canada, Publication Sales. Telephone: 1-800-672-7990 or 1-613-993-2463. Web site: https://www.nrc-cnrc.gc.ca/eng/publications/codes_centre/2015_national_building_code.html.

3 Terms and definitions

For the purposes of this National Standard of Canada, the following terms and definitions apply.

3.1

bottom rail

tubular or fabricated steel section at bottom of fence between posts following grade.

3.2

bottom tension wire

wire installed between fence posts to provide for attachment of chain link fence fabric.

3.3

brace rail

tubular or fabricated steel section used for bracing terminal posts.

3.4

fence posts

upright tubular or fabricated steel member for supporting fencing material.

3.5

hot rings

special wire ties used to tie chain link fabric to bottom wire and top tension wire.

3.6

line posts

fence posts spaced at regular intervals between terminal posts throughout each stretch of fence.

3.7

terminal posts

fence posts which include corner, end, gate and straining posts, as follows:

3.8

corner posts

fence posts positioned at corners and changes of direction greater than ten degrees.

3.9

end posts

fence posts positioned at the ends of a stretch of fence.

3.10
gate posts

two fence posts forming a gateway.

3.11
straining posts

fence posts positioned at changes in grade greater than 30°.

3.12
top rail

a tubular or fabricated steel section continuously joined by means of sleeves or couplings throughout each stretch of fence extending between terminal posts.

3.13
top tension wire

wire installed between fence posts as an option to the top rail.

3.14
wire ties

wire that is used to tie chain link fence fabric to line posts, top rails or bottom wires.

4 General requirements

4.1 All material entering into the chain link fence installation shall be of high quality in every respect. All workmanship shall be in accordance with accepted standards of modern engineering practice. Chain link fence fabric covered by this standard shall be in accordance with CAN/CGSB-138.1.

4.2 Chain link fence framework and gate components covered by this standard shall be in accordance with CAN/CGSB-138.2 and CAN/CGSB-138.4 respectively.

4.3 Construction, including material and workmanship, shall be free from any characteristics or defects which may render the installed chain link fence unsuitable for the intended purpose.

4.4 At the completion of the installation, all debris shall be removed from the site. Earth removed from post holes shall be spread over the area adjacent to the fence lines unless disposal is otherwise specified by the authority applying this standard (see clause 7).

5 Detailed requirements

5.1 Line and level

The fence shall be so installed that on completion it is truly on the line as specified (see clause 7). The top of the fence shall follow approximately the profile of the natural ground or the grade levels as specified (see clause 7).

5.2 Terminal posts

The location of terminal posts, comprising end, gate, corner and straining posts, shall be as specified (see clause 7). A corner post shall be installed at changes of direction greater than ten degrees. A straining post shall be installed at changes in grade greater than 30°. Straining posts shall be spaced no greater than 150 m (500 ft) apart, equally spaced on long runs to assure equal tension of fabric.

5.2.1 Brace rails are recommended at corner, end, gate and straining posts (see Figure 1). Brace rails are required on fences 1.8 m (6 ft) tall and over. Brace rails are installed using rail ends and centre bands at each end.

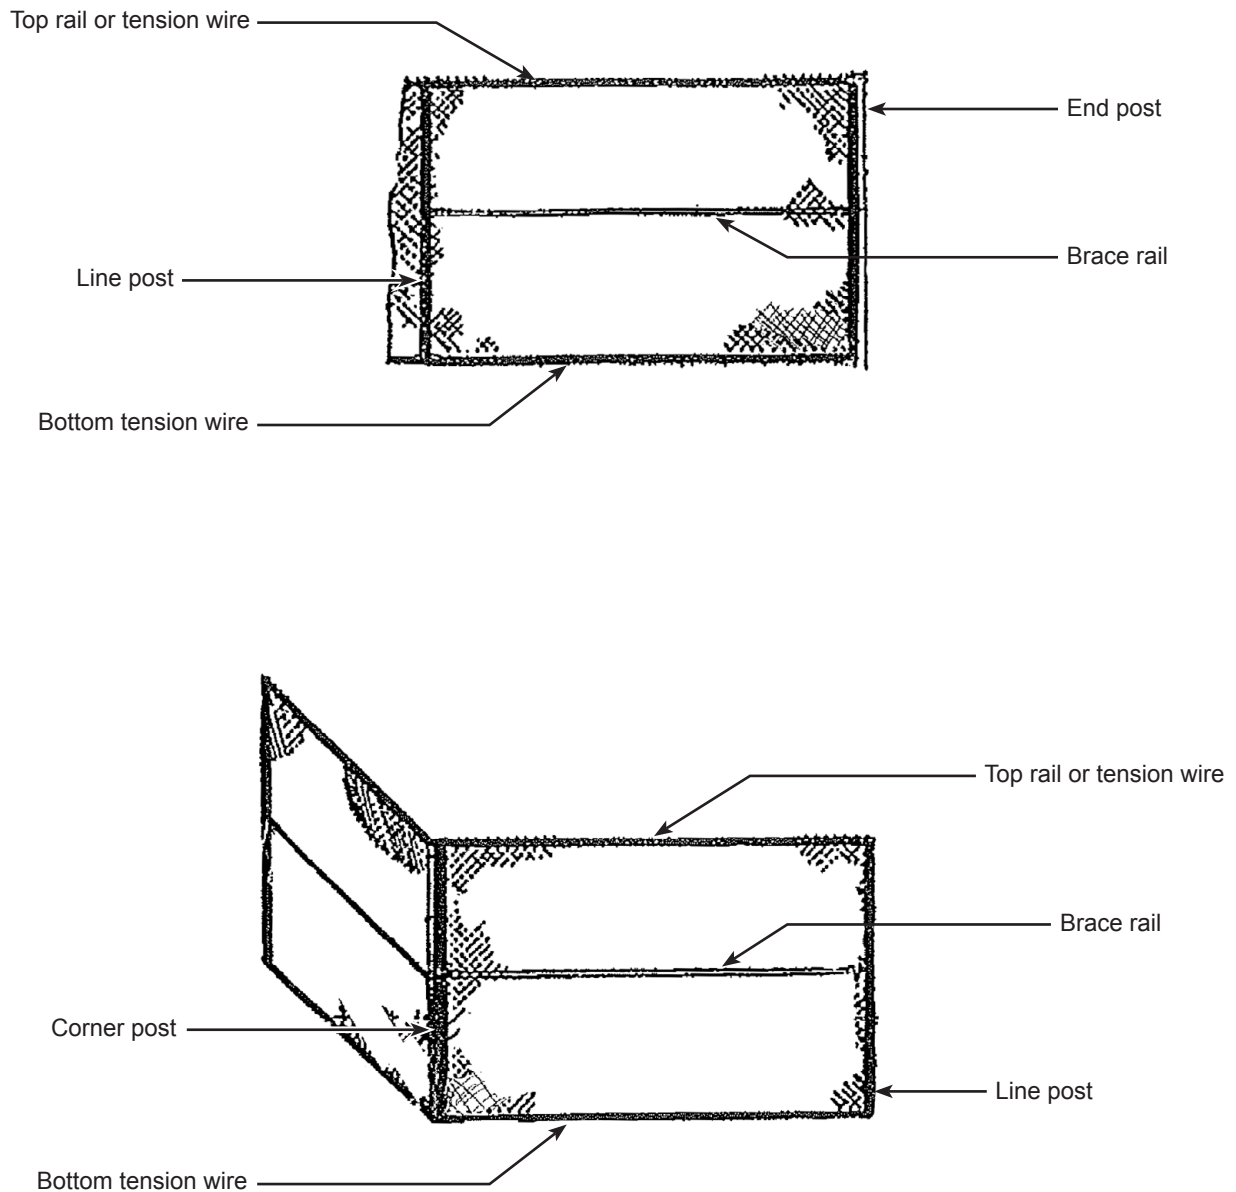


Figure 1 — Application of brace rail and truss rod

5.3 Line posts

Line posts shall be spaced at intervals not to exceed 3.1 m (10 ft) when measured from centre to centre between terminal posts. In determining the post spacing, measurement shall be made parallel to the slope of the natural ground, or grade when specified (see clause 7). All line posts shall be installed in a vertical position.

5.4 Footing design and construction

The basis for any footing design shall be the National Building Code of Canada. The footing (or mechanical device embedded directly in soil) shall be capable of withstanding the specified loadings of terminal and line posts for the type of soil or rock existing at the site where the fence is to be installed. The footing shall have resistance to frost heave and, in general, shall conform to the following requirements:

- a) The depth of footing shall not be less than frost penetration in an average year unless otherwise specified (see clause 7). Footings for corner posts should be 300 mm (12 in.) deeper than for line posts.
- b) There shall be no enlargement of the upper part of the footing. For augered, cylindrical footings, the top 250 mm (10 in.) of concrete may have to be formed to prevent this condition and to provide a smooth surface to break the frost grip of the surface soil.
- c) All materials used in footing construction shall be durable. Concrete shall exhibit a minimum strength of 20 MPa after 28 d. Any embedded steel components shall be hot-dip galvanized in accordance with the requirements of CAN/CSA G164.

5.4.1 Soil footings¹

The procedure followed in constructing soil footings shall require earth-augering the hole, plumbing and setting the post. The post shall be imbedded directly into concrete and no closer than 150 mm (6 in.) from bottom of hole. Figure 2 shows details and dimensions for typical soil footing designs in average soil conditions, based on the use of galvanized steel pipe conforming to CAN/CGSB-138.2 as fence post material. The dimensions shown shall be treated as minimum dimensions unless a detailed soil investigation has been made and footings designed in accordance with the requirements specified in 5.4.

¹ Footing construction is not suitable where the soil is unstable, or in fill that has not been properly consolidated, or in areas subject to unusually severe frost or frost heaving.

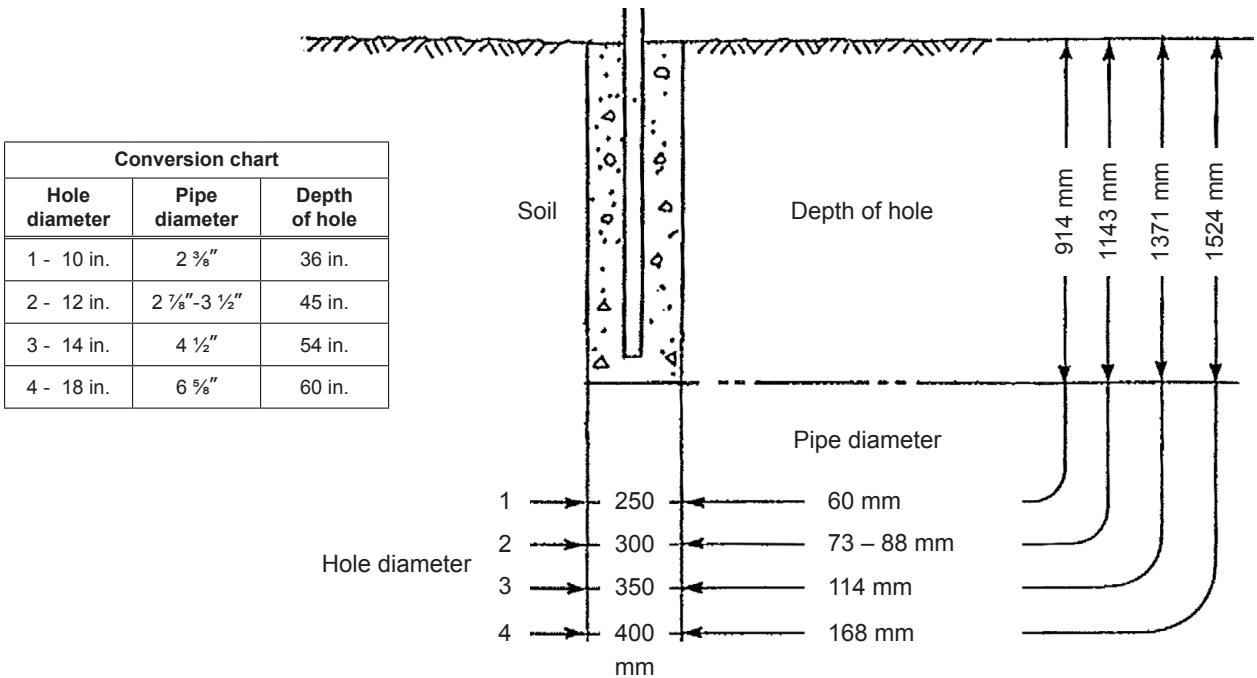


Figure 2 — Footing in average soil conditions

5.4.2 Solid rock footings

Figure 3 shows a typical design of footing in solid rock where there is overburden. Figure 4 shows the footing in solid rock where there is no overburden. In each case, the hole in the solid rock is approximately 25 mm (1 in.) larger than the diameter of the pipe and, after the post has been set and plumbed, the hole is filled with non shrink grout. Other approved grouting materials may be specified (see clause 7).

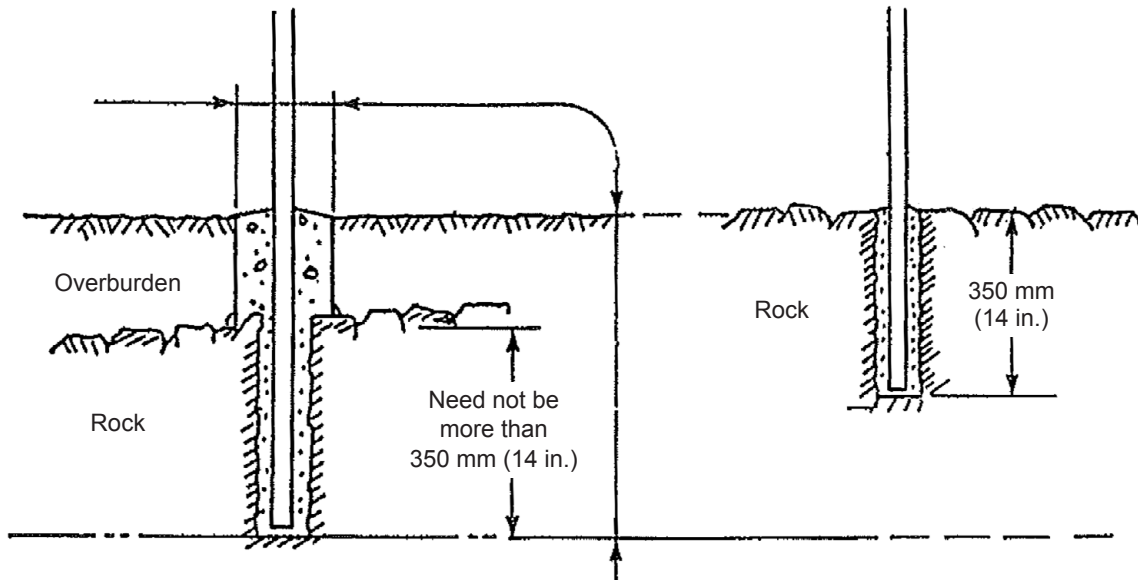


Figure 3 — Footing in partly solid rock

Figure 4 — Footing in solid rock

5.4.3 Mechanically driven posts directly in soil

For use on light commercial applications, where a detailed soil investigation has been made. Based on the use of galvanized steel pipe conforming to CAN/CGSB-138.2 as fence post material. All posts shall be at least 300 mm (12 in.) longer in length depending on soil conditions. Not recommended for corner, end, gate and straining posts. Follow 5.4.1 and 5.4.2 for all terminal posts.

5.5 Post setting

All fence posts shall be plumb and aligned accurately. They may be anchored directly in rock with grout. In such cases and where concrete is not provided between rock level and grade level, the height of fence for design sizing purposes in accordance with CAN/CGSB-138.2 shall be taken as the height above grade plus the distance from grade level to rock level or the overall length of the post whichever is less. Backfill around footings shall be thoroughly stamped in 150 mm (6 in.) layers. Soil unsuitable for consolidation shall not be used. Where earth augering is used, the hole shall be free of water and any loose soil in the bottom of the footing shall be removed and compacted to provide a solid bottom. Posts shall be imbedded directly into concrete and no closer than 150 mm (6 in.) from bottom of hole.

5.5.1 Top rail or top wire and other horizontal rails (e.g. centre and bottom rails) as described in CAN/CGSB-138.2 should be installed using water proof line caps appropriate for each application. Top rail shall be attached with rail ends and centre bands at all terminal posts. Chain link fence located in close proximity to highways should not use top rail or bracing (check with local regulatory bodies). Bottom and top wires should be fastened securely to all terminal posts so wire is taut.

5.6 Chain link fence

The chain link fabric shall be installed on the outside of the fence unless requirements for installation on the inside of the fence is specified (see clause 7). The fabric shall be stretched taut approximately 50 mm (2 in.) above the natural ground or grade level and securely fastened to the terminal posts with steel tension bars and tension bands. The fabric shall be tailored for each span of fence and attached independently at all terminal posts. Fastening to line posts shall be with wire ties, metal bands or clips, or other approved methods, attached at maximum 400 mm (16 in.) intervals. The top edge of the fabric shall be fastened to the top rail with wire ties at intervals not exceeding 600 mm (24 in.). The bottom edge of the fabric shall be fastened to the bottom wire with wire ties, hog rings, or knuckling bottom wire in knuckled selvage, at intervals not exceeding 600 mm (24 in.). Rolls of fabric shall be joined by weaving a single strand of fabric into the ends of the rolls to form a continuous mesh.

5.6.1 Wire ties (see Figure 5)

Posts and rails shall be fastened using manually fastened wire ties or power fastened wire ties (see clause 7).

Manually fastened wire ties shall attach one strand of chain link fabric to the posts and rail by hooking or twisting (two complete turns) one end of the tie to the fabric and tightly wrapping the tie around the post or rail having the remaining end of tie secured to the fence fabric with two twists drawing the tie tight. Power fastened wire ties shall be installed as per manufactures instructions. The end of the tie shall be positioned on post or rail so that it is parallel to the chain link fabric. The end of wire ties shall not protrude beyond the vertical plane of chain link fabric. Ties shall be down tight to posts or rails after twisting.

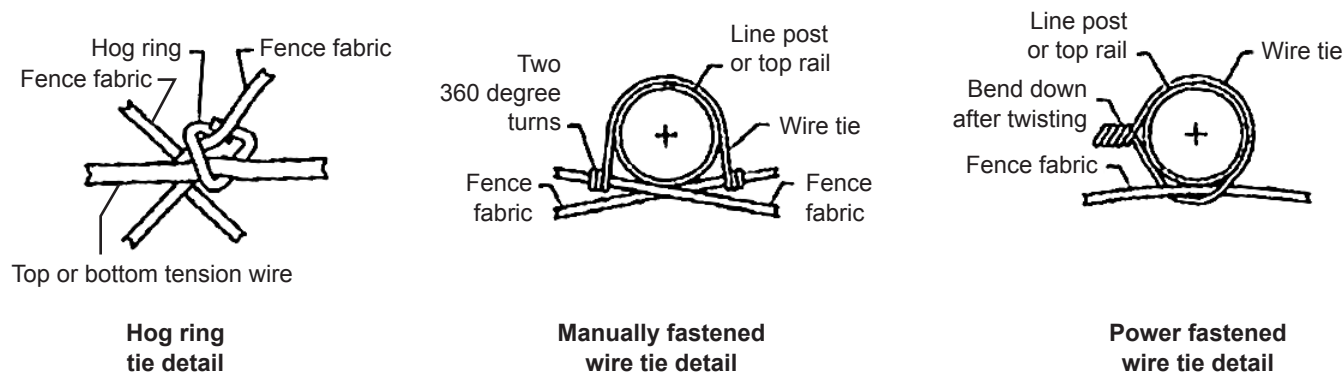


Figure 5 — Tying options

5.7 Barbed wire

For safety reasons and as specified in CAN/CGSB-138.2, barbed wire shall not be installed on fences that are less than 1.8 m (6 ft) in height prior to installation of the barbed wire.

6 Inspection

All parts of the chain link fence installation shall be visually inspected to determine their conformance with the workmanship, design, and dimensional requirements of this standard.

7 Options

The following options shall be specified in the application of this standard.

- a) Requirements for disposal of earth removed from post holes (see 4.4)
- b) Line and level requirements for fence installation (see 5.1)
- c) Grade specification (see 5.1)
- d) Location of terminal posts (see 5.2)
- e) Line post spacing (see 5.3)
- f) Depth of footing (see 5.4 a)
- g) Grouting materials (see 5.4.2)
- h) Requirements for installation of chain link fabric on inside of fence (see 5.6)
- i) Choice of wire ties (see 5.6.1).